



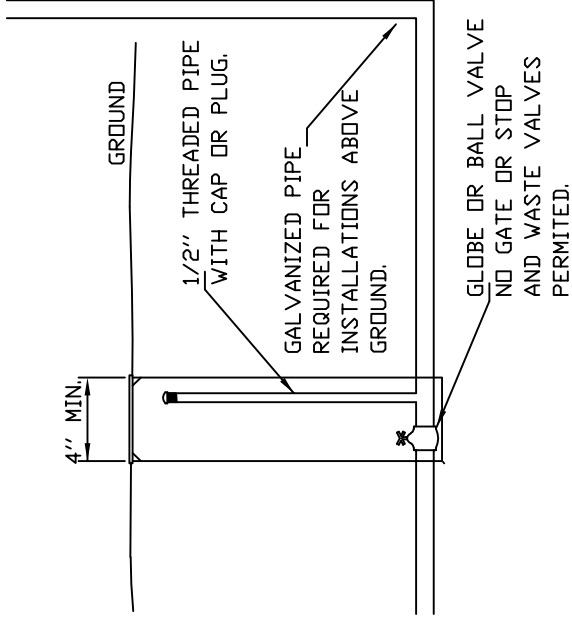

PVBA INSTALLATION

NOTES:

- 1) PVBA MAY BE INSTALLED ON LOW HAZARD POTABLE WATER SUPPLY SYSTEMS ONLY.
- 2) A CITY OF ELLENSBURG CROSS CONNECTION SPECIALIST MUST BE PRESENT DURING INSTALLATION.
- 3) PVBA MUST BE INSTALLED NOT LESS THAN 12" ABOVE THE HIGHEST POINT OF USE AND NOT MORE THAN 60" HIGH.

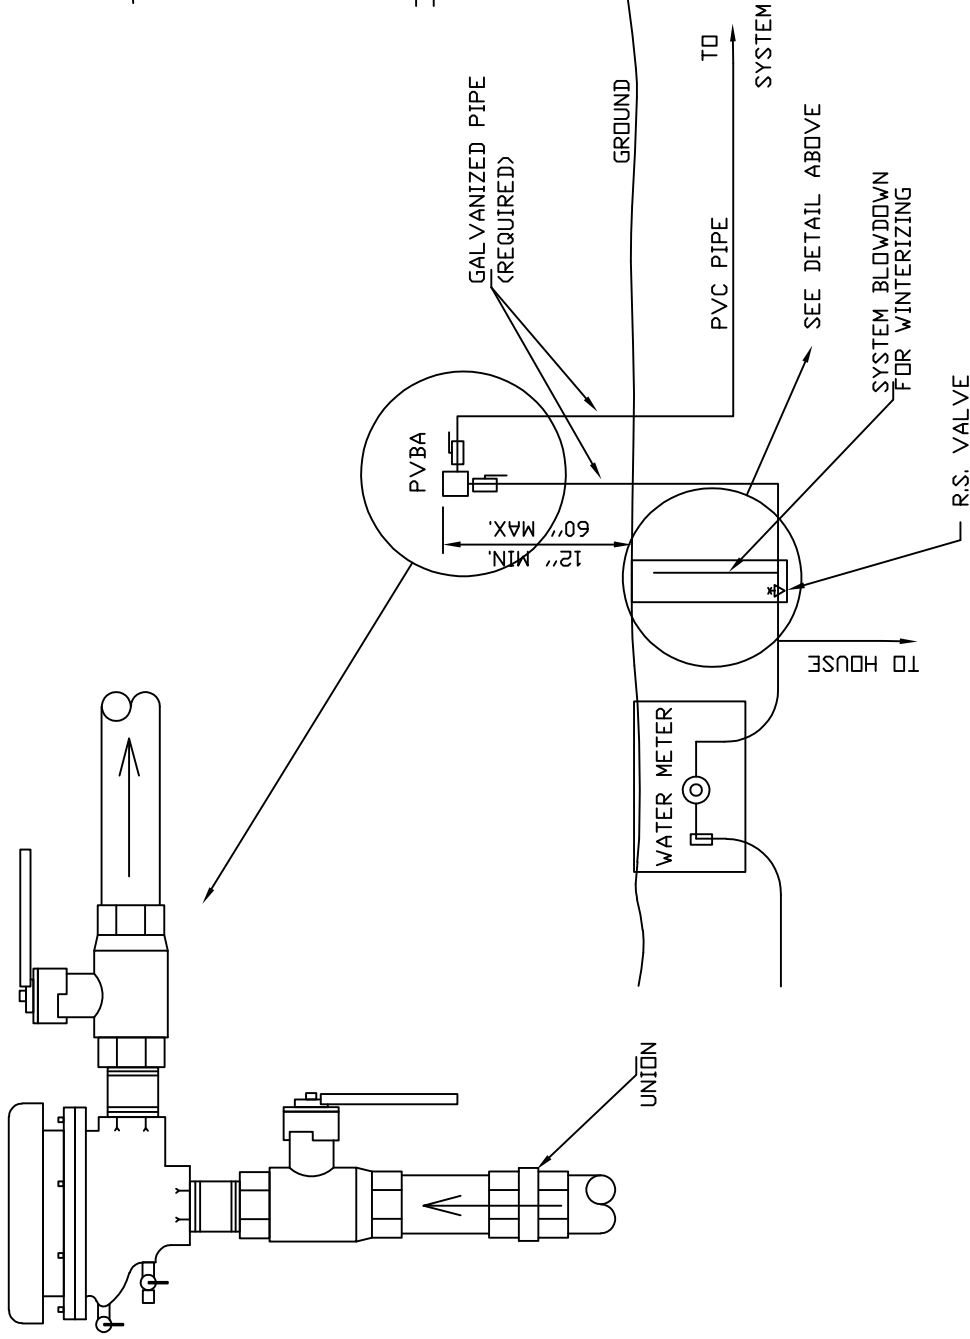

CITY OF ELLENSBURG
STANDARD PLANS & DETAILS

DRAWN BY: HLG
DATE: 09-20-96
UPDATED BY: DKM
SCALE: NONE

PVBA INSTALLATION

PLAN NO.

WT-75

REVISED 12-28-04