

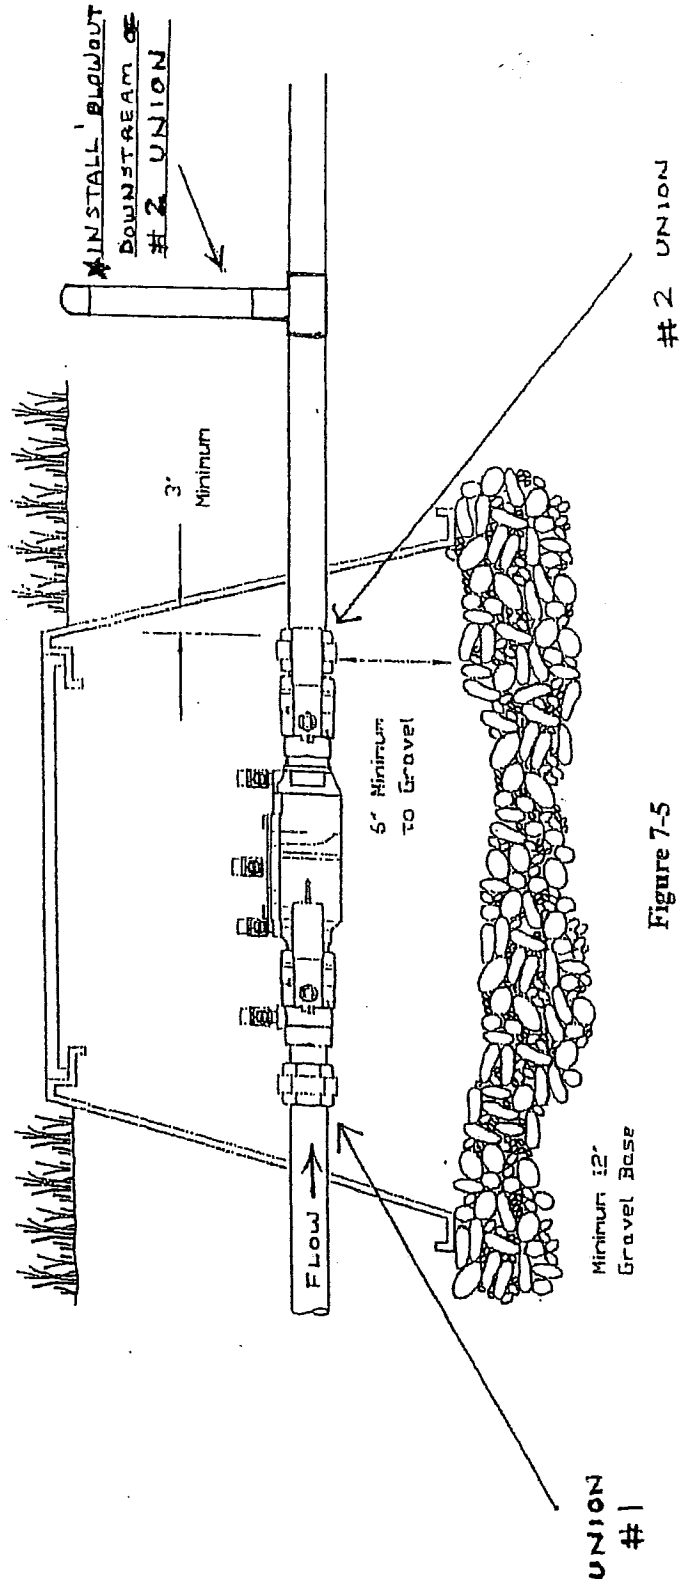


Figure 7-5  
Small DCVA Installation - Below Ground Box

#### UNIFORM PLUMBING CODE

**609.5 Unions.** Unions shall be installed in the water supply piping within twelve (12) inches (305 mm) of regulating equipment, water heating, conditioning tanks, and similar equipment that may require service by removal or replacement in a manner that will facilitate its ready removal.