


TYPICAL TEMPORARY METER-BASE REQUIREMENTS

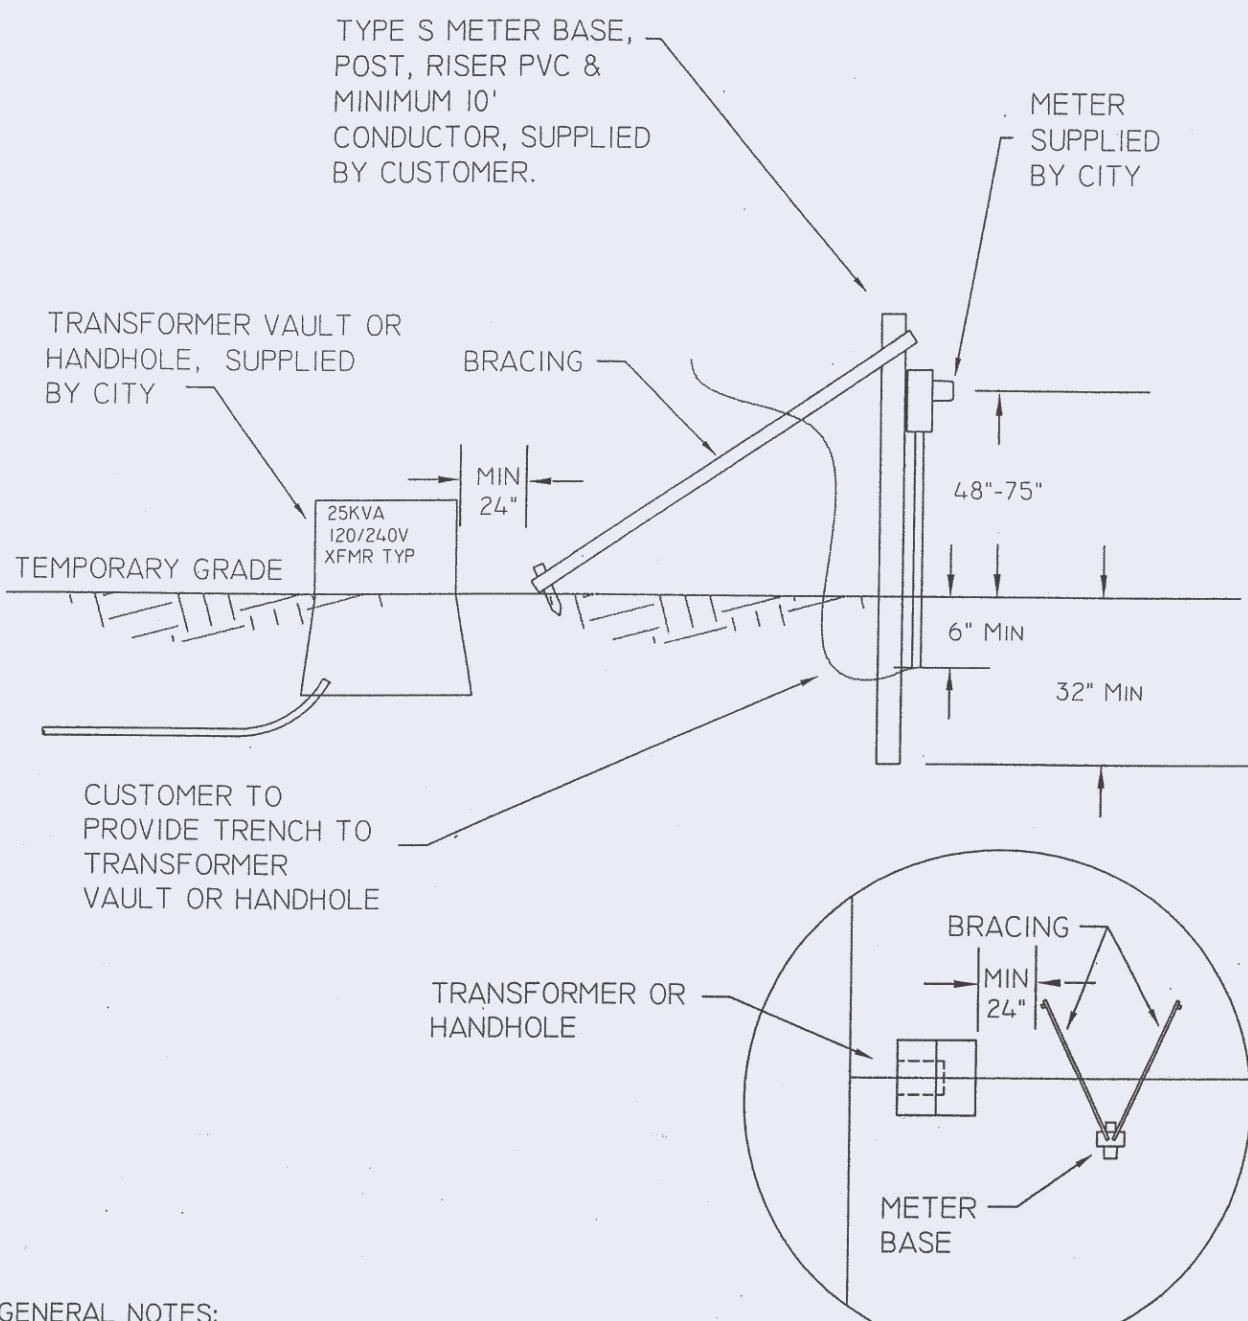

GENERAL NOTES:

USE 4 TERMINAL METER BASE FOR SINGLE PHASE 120/240V.
CONTACT ENGINEERING FOR OTHER VOLTAGES.
CUSTOMER MUST ALSO INSTALL METER BASE & SERVICE
PER NEC. & STATE INSPECTOR.

City of Ellensburg - Energy Services
Standard Design Practices

**TEMPORARY ELECTRICAL
METER-BASE REQUIREMENTS**

APPROVED BY: WW

SCALE: NTS

FILE NAME:

PLAN NUMBER:

DRAWN BY: MIB

DATE: 5/13/2005

\\PROJECT\\STANDARDS\\DETAILS\\L3.DWG

L-3