


Any Questions contact City of Ellensburg Gas Division at 509-962-7124

REVISED XX-XX-XX

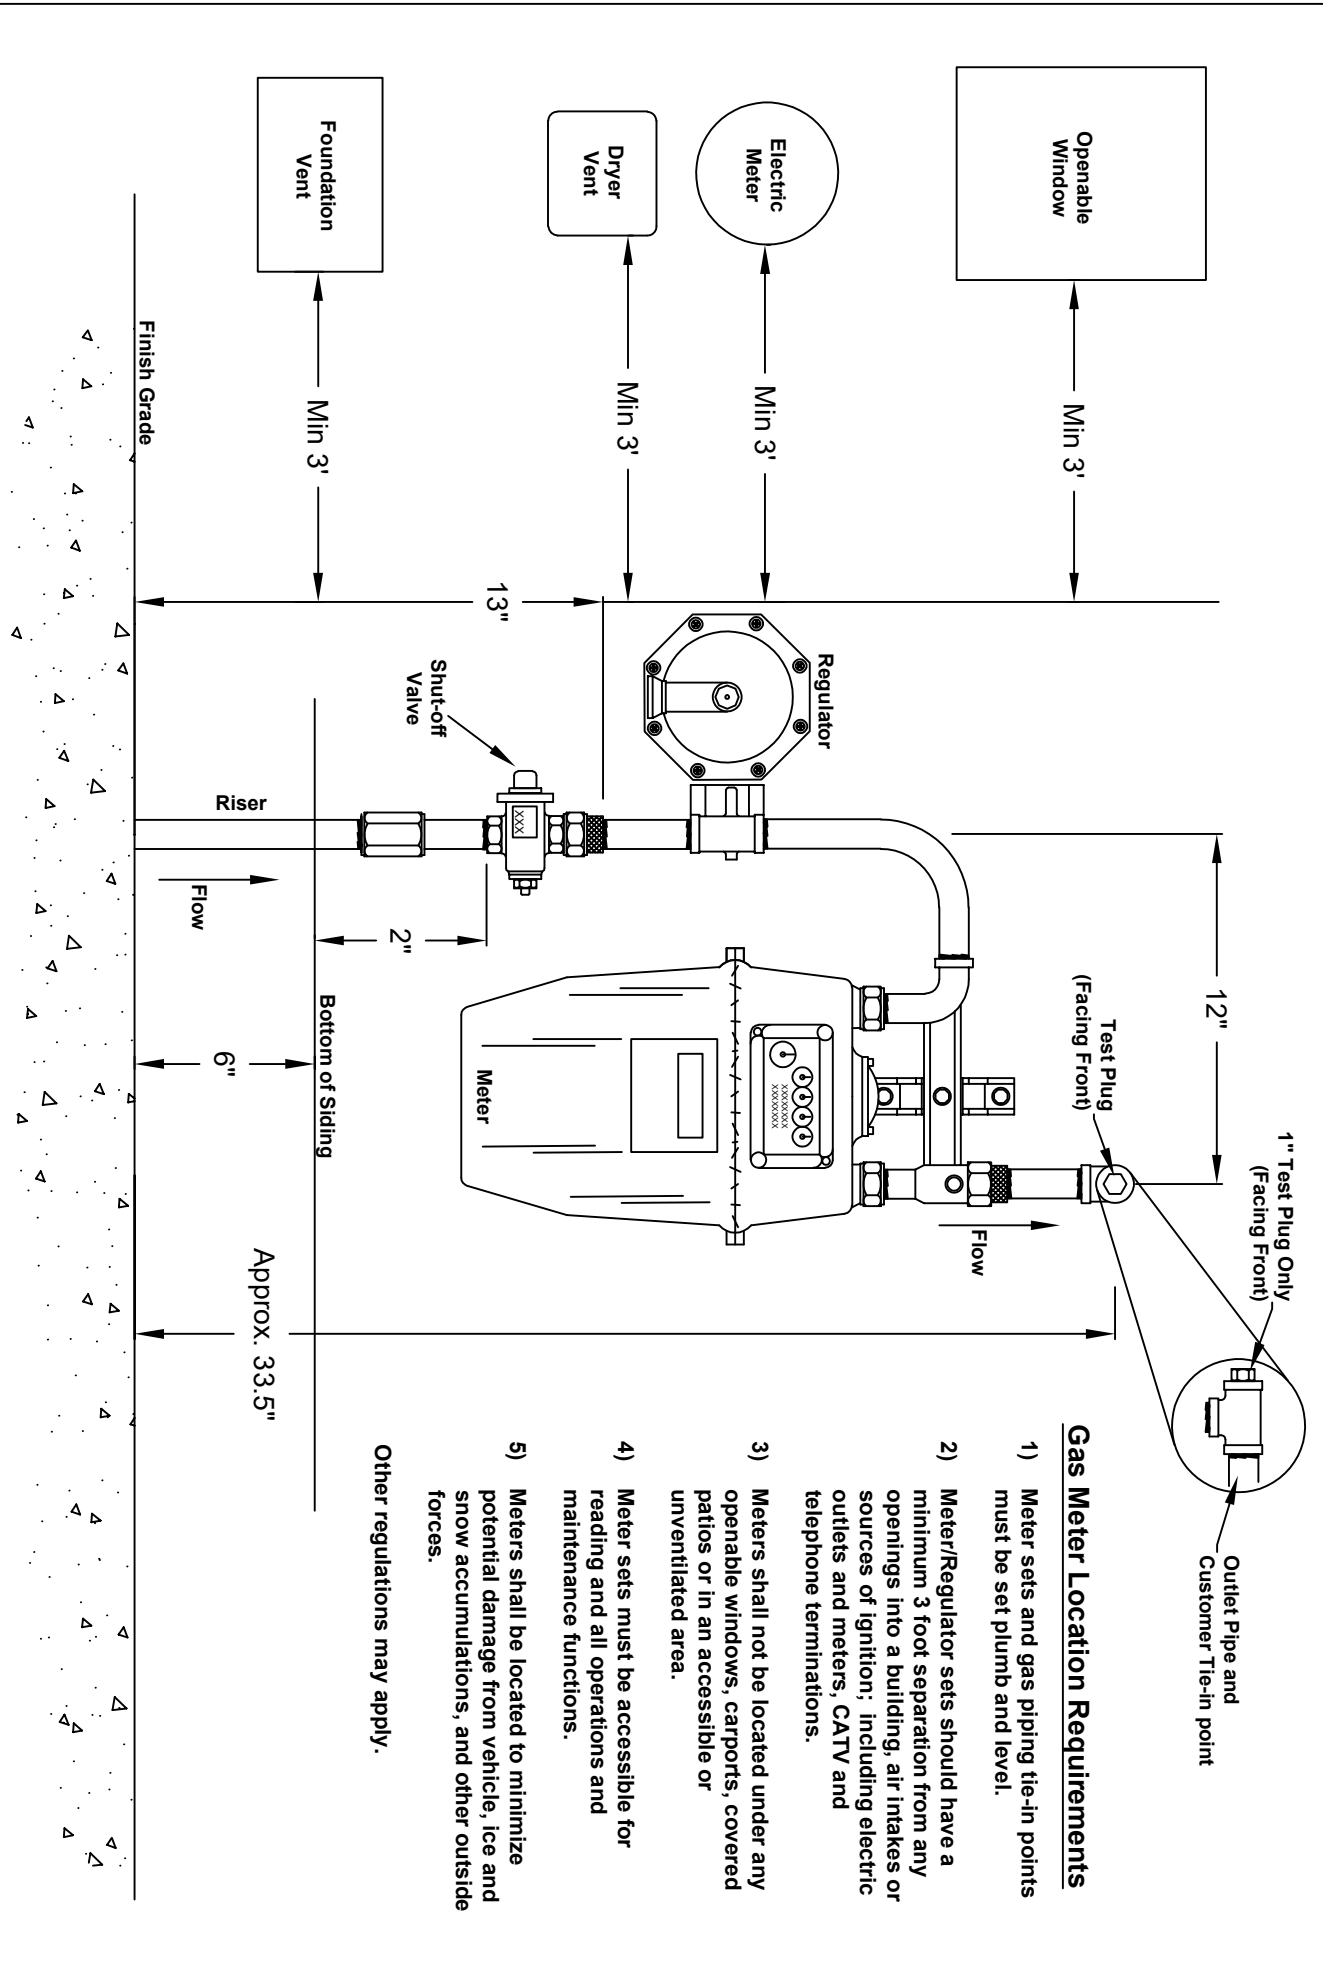

Gas Meter Location Requirements

- 1) Meter sets and gas piping tie-in points must be set plumb and level.
 - 2) Meter/Regulator sets should have a minimum 3 foot separation from any openings into a building, air intakes or sources of ignition; including electric outlets and meters, CATV and telephone terminations.
 - 3) Meters shall not be located under any operable windows, carports, covered patios or in an accessible or unventilated area.
 - 4) Meter sets must be accessible for reading and all operations and maintenance functions.
 - 5) Meters shall be located to minimize potential damage from vehicle, ice and snow accumulations, and other outside forces.
- Other regulations may apply.